


Schematic diagram of installation on foundation

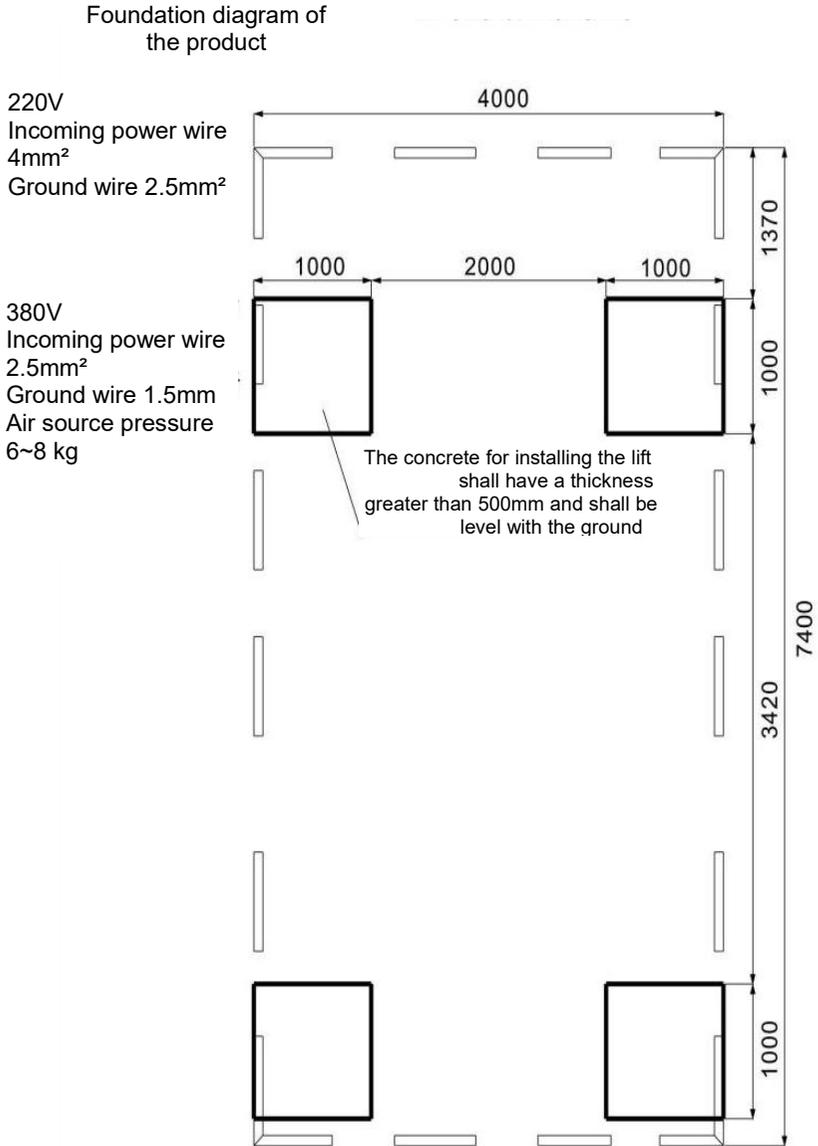

Note:

1. The concrete shall be reinforced with steel, and have a thickness greater than 500mm and a compressive strength not lower than 25MPa.
2. The grade of the foundation concrete shall be greater than C25.
3. The lift station is recommended to have a length of 7,400mm.

Schematic diagram

